

K6 Softstarter


Start ramp 5 s.

Stop ramp 10 s.


Initial voltage 40%

Tightness control

Waiting time for prepurging:
Adjust parameter (KM) 32 on 100 (10 sec.).

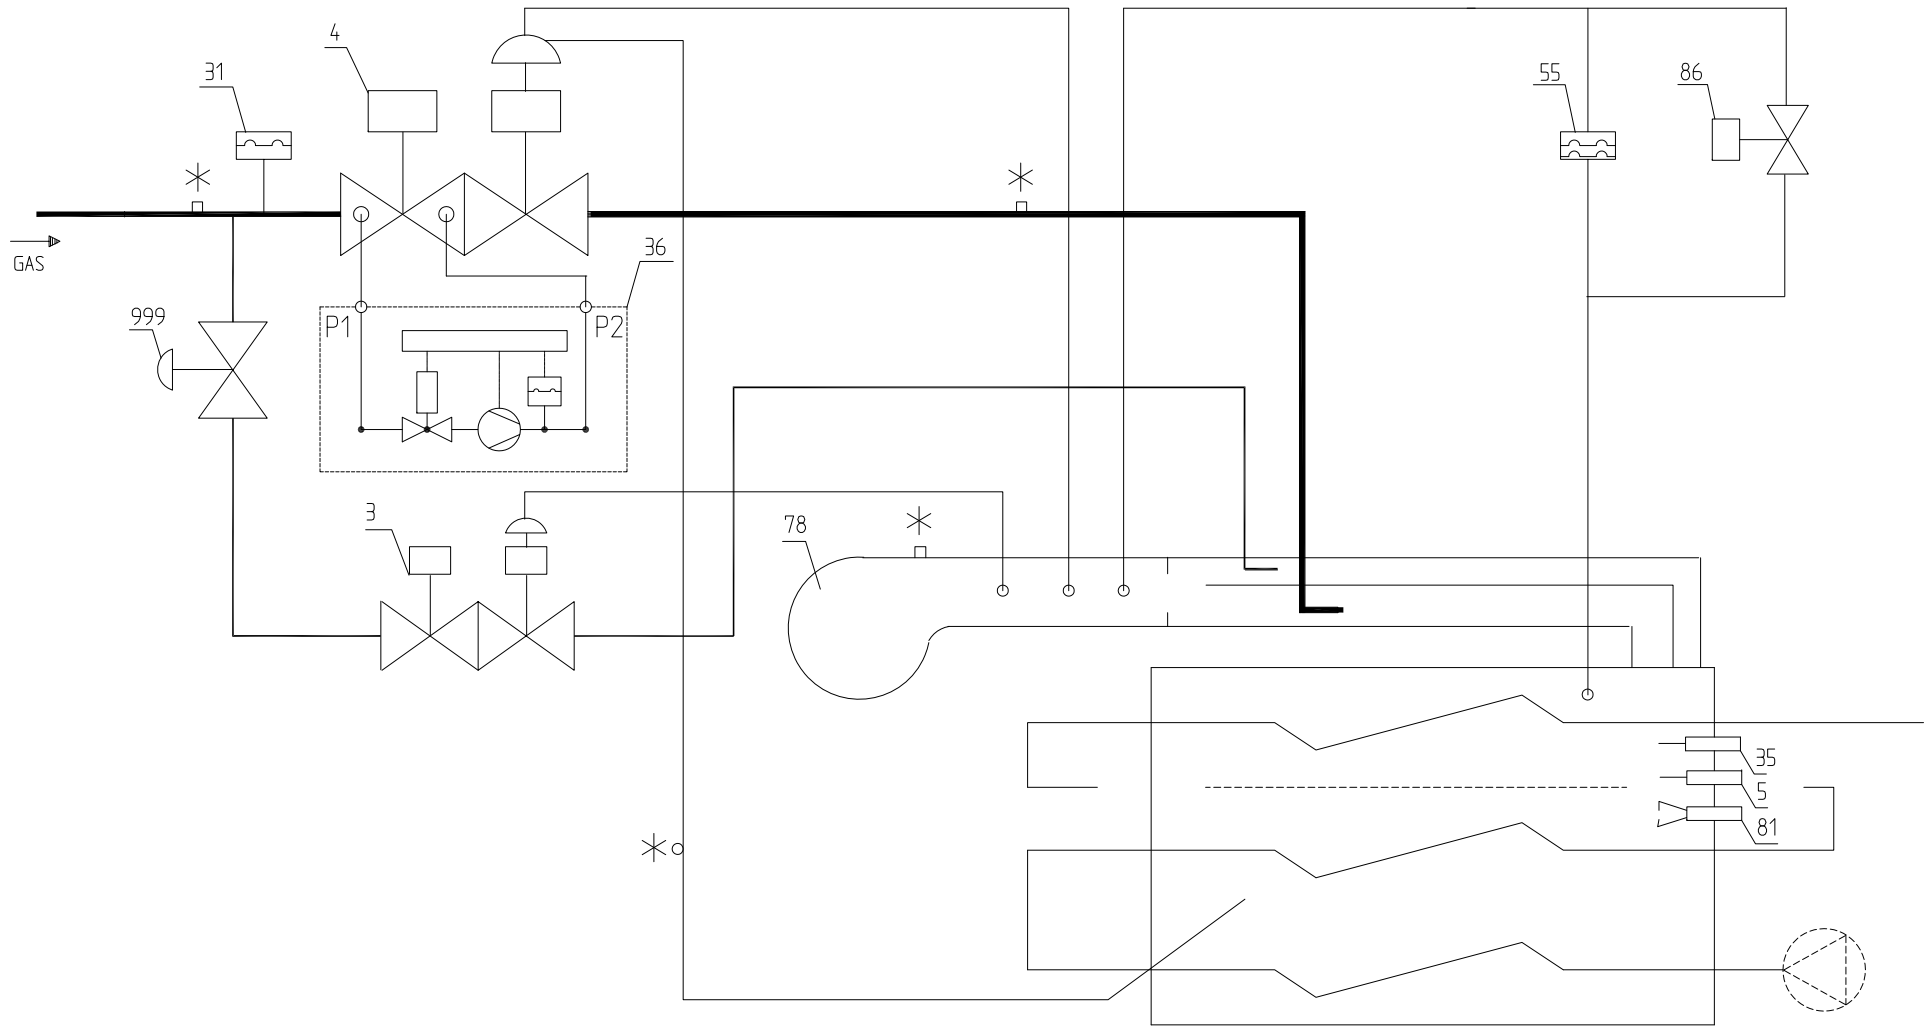

* Measure point

		Gastrain R3400	R3400 type 7-8
		 Rendamax	DAT. 15-07-2013
			GET. R.L.
			GEC. R.L.
			B3407E202
			Page 2 - 2